


External ID

Name	Date of Birth	Order ID
First Name	Sex	Order Date
Sampling Date	Validation by	Findings Status
Sample Material	Validation Date	Findings Date
	Dr. Herbert Schmidt	Final Report

Test	Result	Unit	Standard Range	Previous Result
------	--------	------	----------------	-----------------

Special gastro-enterological diagnostics

SIBO-Test

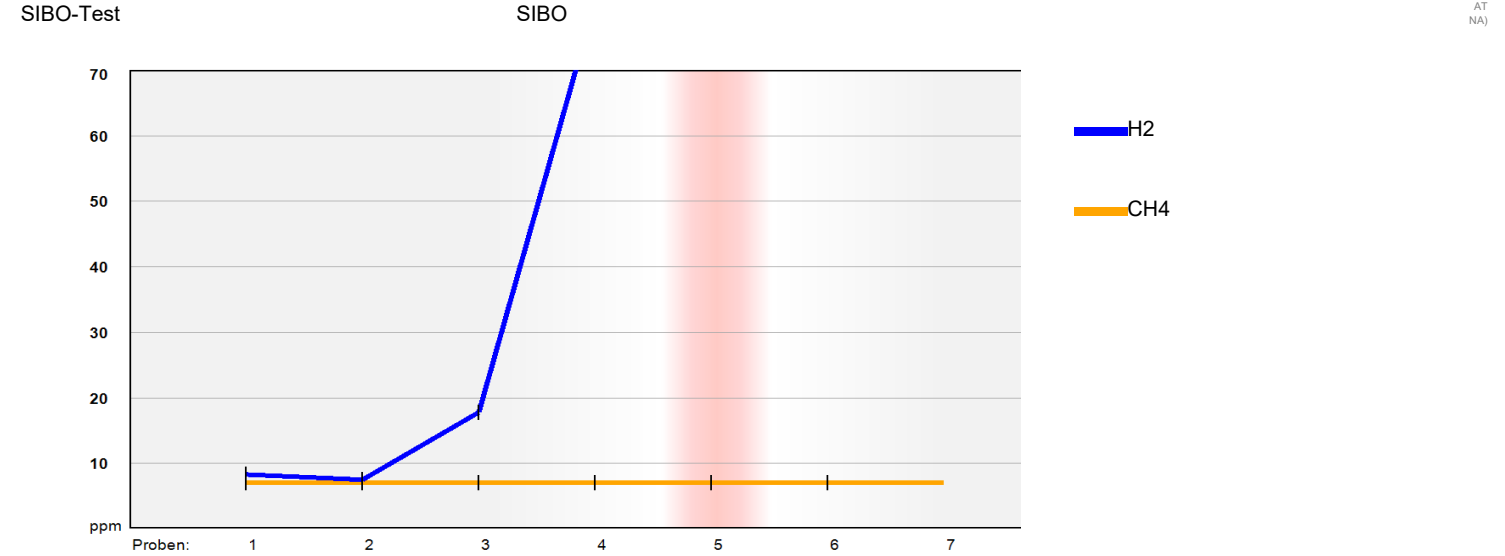

SIBO test (hydrogen)

Breathing Gas 1	8,3	ppm	< 20	AT NA) GC
Breathing Gas 2	7,5	ppm	< 20	AT NA) GC
Breathing Gas 3	17,8	ppm	< 20	AT NA) GC
Breathing Gas 4	80,5	ppm	< 20	AT NA) GC
Breathing Gas 5	103,1	ppm	< 20	AT NA) GC
Breathing Gas 6	103,9	ppm	< 20	AT NA) GC
Breathing Gas 7	121,9	ppm	< 20	AT NA) GC

SIBO test (methane)

Breathing Gas 1	<8,0	ppm	< 10	AT NA) GC
Breathing Gas 2	<8,0	ppm	< 10	AT NA) GC
Breathing Gas 3	<8,0	ppm	< 10	AT NA) GC
Breathing Gas 4	<8,0	ppm	< 10	AT NA) GC
Breathing Gas 5	<8,0	ppm	< 10	AT NA) GC
Breathing Gas 6	<8,0	ppm	< 10	AT NA) GC
Breathing Gas 7	<8,0	ppm	< 10	AT NA) GC